

Infiltration Trench or Basin Multi-Benefit Full Capture Systems

June 2023

This information sheet generically describes the categorically certified Infiltration Trench or Basin Multi-Benefit Full Capture Systems and the associated specific design requirements.



Figure A: Photograph of an Urban Infiltration Trench

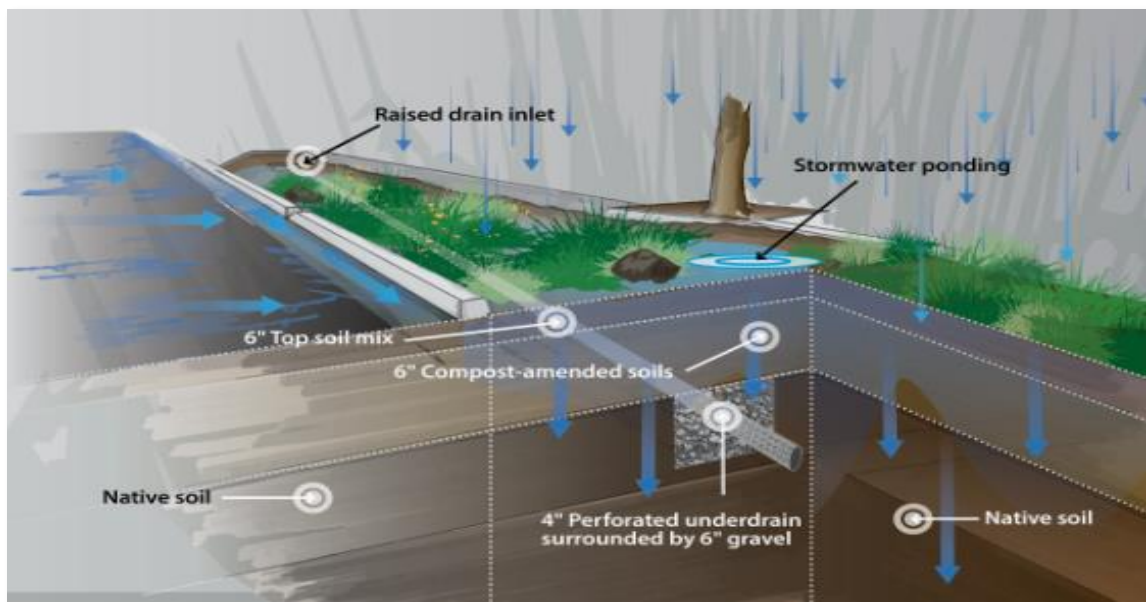


Figure B: Generic Urban Infiltration Trench Detail

Description

Infiltration Trench or Basin Multi-Benefit Trash Treatment Systems

An Infiltration Trench or Basin Multi-Benefit Full Capture System (Infiltration Trench) removes pollutants from stormwater runoff and captures and infiltrates stormwater runoff (see Figures A and B). Infiltration Trenches may be backfilled with porous media such as gravel, sand, soil, or various locally earthed rocks (assuming such media does not generate pollutants of concern). These Infiltration Trenches store water for infiltration to underlying soils.

The subsurface of the Infiltration Trench may include perforated pipes, chambers, open bottom concrete galleries or other high voids structures designed to temporarily store water prior to infiltration.

The surface of the Infiltration Trench must have a surface area large enough to trap trash and reduce the risk of trash and other debris (e.g., vegetation) interfering with the hydraulic capacity of the Infiltration Trench.

Multi-Benefit Certification Limitations

The following systems must be individually certified through the State Water Board's Full Capture System certification process, regardless of whether they otherwise meet the conditions of this certification:

- Pre-manufactured systems (i.e., those manufactured off-site that are generally available for sale);
- Systems inserted into the existing storm drain infrastructure (e.g., storm vaults); and
- Systems that are designed to contain water for more than 96 hours after conclusion of a storm event in an underground system of pipes, chambers, concrete vaults, or similar void structures connected to exterior inlets or outlets.

Performance, Design, and Maintenance

Permittees and other responsible entities¹ shall design, construct, and maintain [Infiltration Trenches](#) in accordance with the following six (6) requirements:

1. Infiltration Trenches shall trap particles that are 5 millimeters or greater at any time during a storm event for the following:
 - a. The peak flow rate generated by the region specific 1-year, 1-hour storm event from the applicable sub-drainage area; or
 - b. The peak flow rate of the corresponding storm drain (if the Infiltration Trench is designed to treat flows from the corresponding storm drain that is designed for less than the peak flow rate generated from a 1-year, 1-hour storm event).
2. Infiltration Trenches may include either or both of the following to trap particles for either flow described above in section 1.a or 1.b:
 - a. A screen at the system's inlet, overflow, or bypass outlet; or
 - b. An up-gradient structure designed to bypass flows exceeding the flows as described in

¹ These requirements also apply to any entity designing a Infiltration Trench to comply with a Water Board permit or a permittee's requirements implementing the Trash Provisions.

Infiltration Trench or Basin
Multi-Benefit Trash Treatment Systems

section 1.a or 1.b²

3. The peak flow rates referenced in section 1.a, above, shall be calculated using one of the following methods:
 - a. For small drainage areas (generally less than 50 acres) – The Rational equation method which is expressed as $Q = CIA$ where:
 - Q = design flow rate (cubic feet per second)
 - C = runoff coefficient (dimensionless)
 - I = design rainfall intensity (as determined per the rainfall isohyetal map specific for each region) specific to each region, inches/hour
 - A = subdrainage area (acres)
 - b. For large drainage areas (generally more than 50 acres or more) – Other accepted hydrologic mathematical methods that more accurately calculate peak flow rates from large drainage areas.
4. For the purpose of requirements related to the peak flow rates in item 1, above, the percolation rate below the Infiltration Trench must either be measured directly or estimated employing conservative hydrogeologic assumptions.
5. A registered California licensed Professional Engineer shall stamp and sign the Infiltration Trench design plans as required by California Business & Professions Code section 6700, et seq.
6. Because regular maintenance is required to maintain adequate trash capture capacity and to ensure that captured trash does not migrate offsite, the Permittee shall establish a maintenance schedule based on:
 - a. The maintenance frequency as required in the applicable State or Regional Water Board stormwater permit; and
 - b. Site-specific factors including the design trash capture capacity of the Infiltration Trench, local storm frequency, and characterization of trash and vegetation accumulation in the corresponding sub-drainage area.

² Upon approval by the appropriate Regional Water Quality Control Board Executive Officer, a 5 millimeter screen and/or upgradient structure may not be required if the Infiltration Trench is designed for flood control from flows generated by very large storm events.